AIR CONDITIONING JOBSITE INFORMATION SHEET

REMEMBER:

1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Circle Service Ports used.
4. Sat. Temp. is pressure converted to Temp.

Formula For Super Heat	
_____	Vapor Line Temp.
– _____	Minus Sat Temp.
_____	Equals Super Heat

Formula For Sub Cooling	
_____	Sat Temp.
– _____	Minus Liquid Line Temp.
_____	Equals Sub Cooling

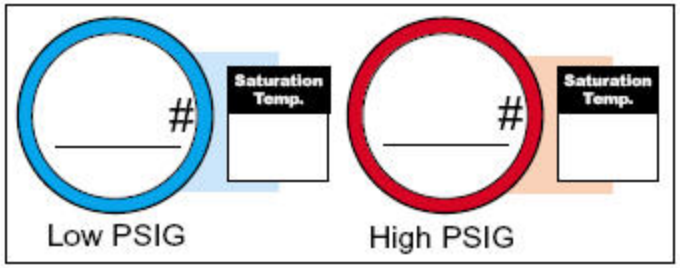

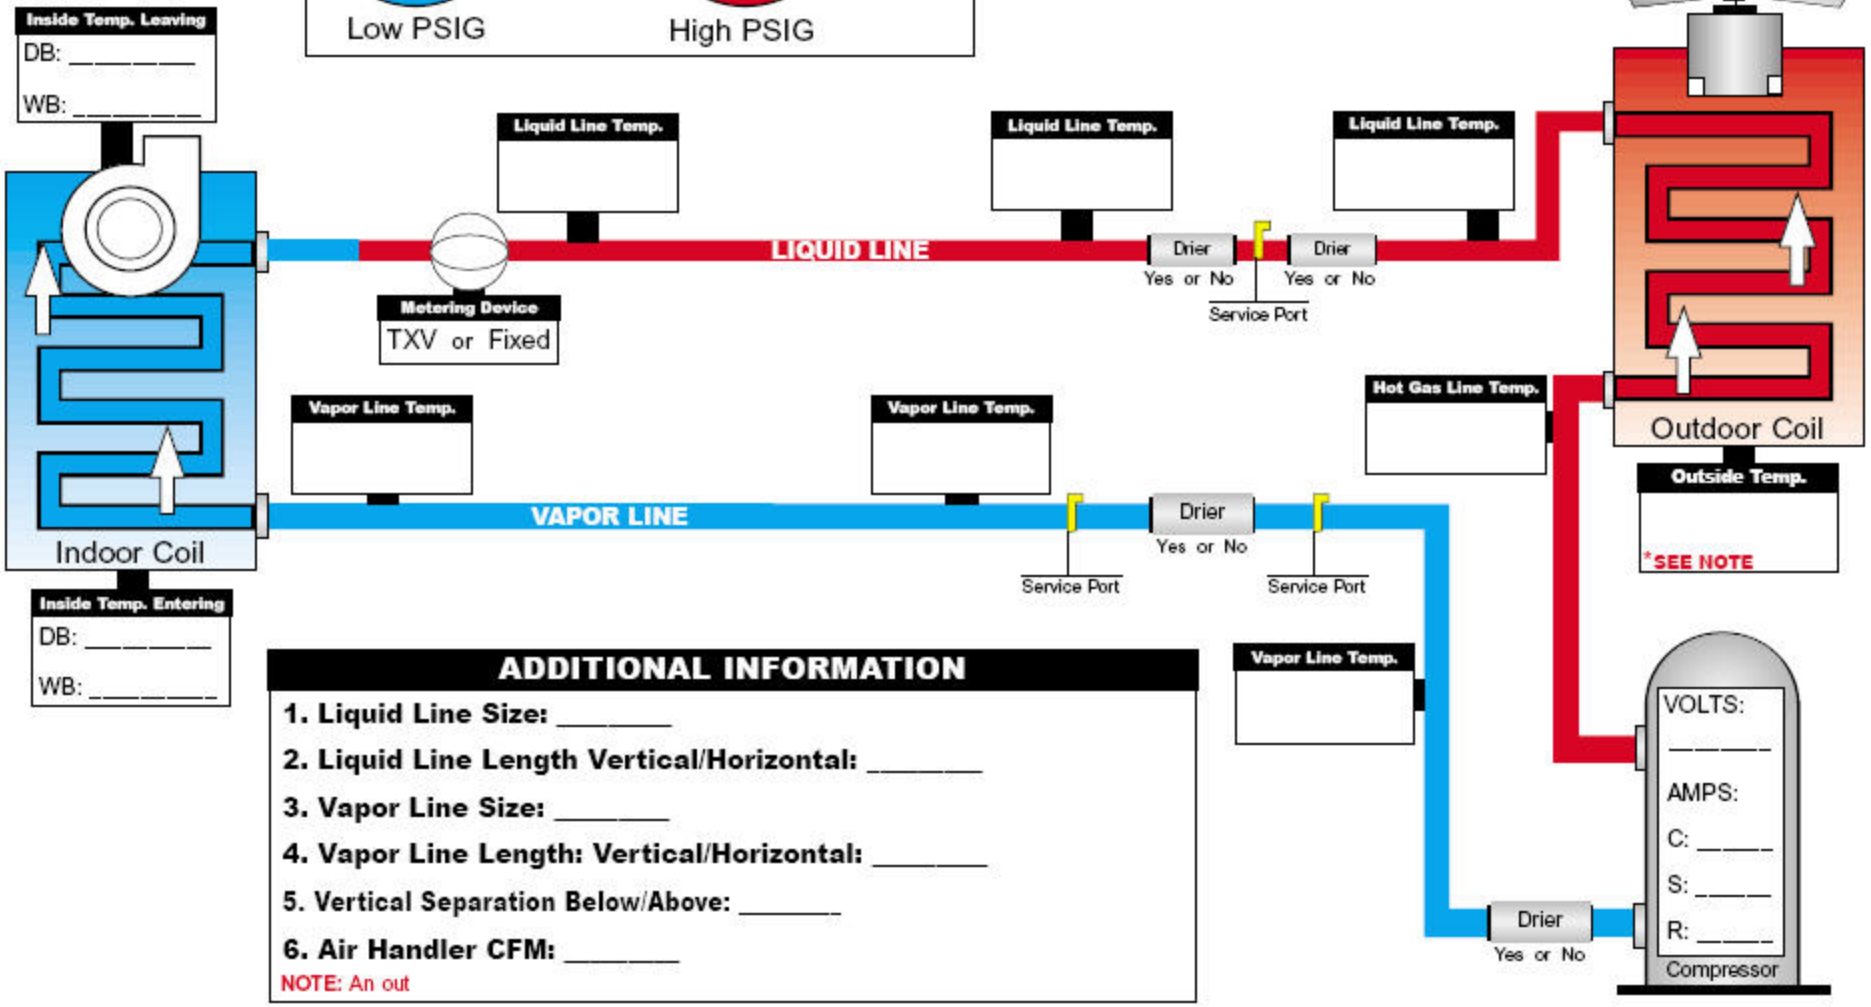

ADDITIONAL INFORMATION

1. Liquid Line Size: _____
2. Liquid Line Length Vertical/Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length: Vertical/Horizontal: _____
5. Vertical Separation Below/Above: _____
6. Air Handler CFM: _____

NOTE: An out