


AIR CONDITIONING JOBSITE INFORMATION SHEET

REMEMBER:

1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Circle Service Ports used.
4. Sat. Temp. is pressure converted to Temp.

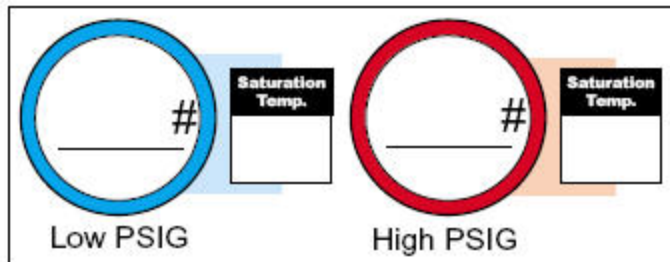

Formula For Super Heat

Vapor Line Temp.

Minus Sat Temp.


Equals Super Heat

Formula For Sub Cooling

Sat Temp.

Minus Liquid Line Temp.

Equals Sub Cooling

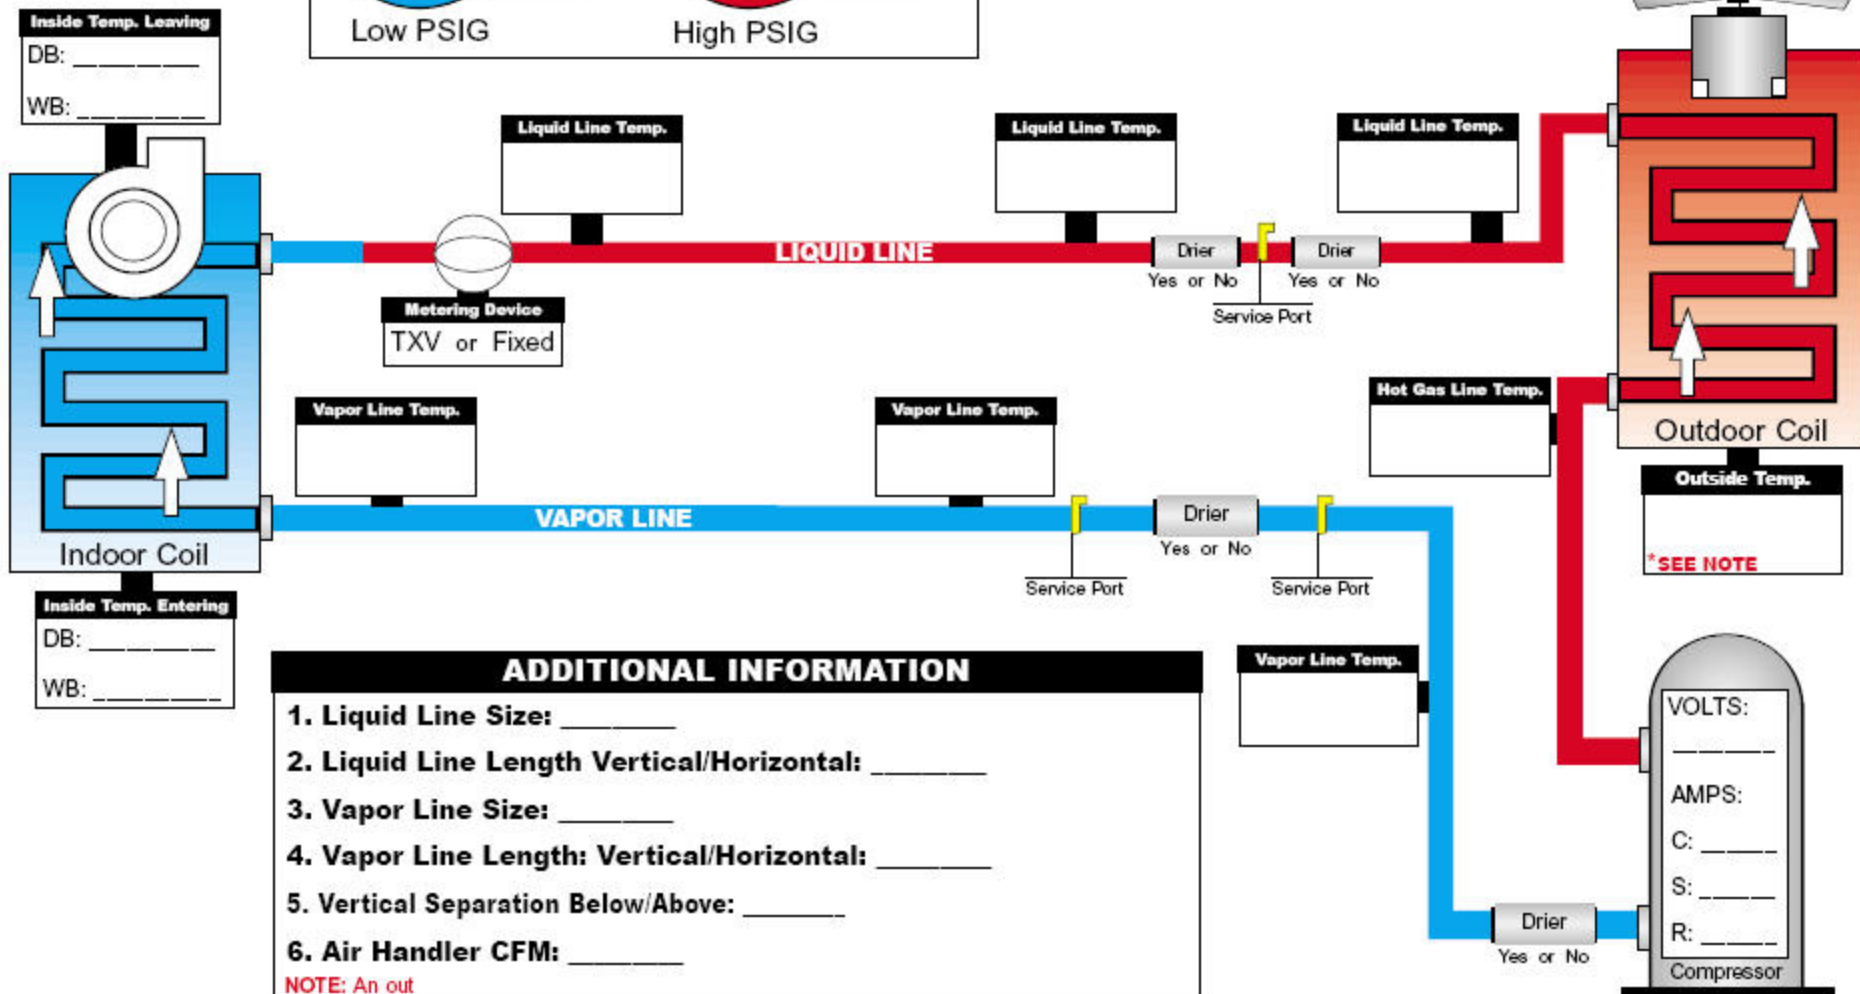

ADDITIONAL INFORMATION

1. Liquid Line Size: _____
2. Liquid Line Length Vertical/Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length: Vertical/Horizontal: _____
5. Vertical Separation Below/Above: _____
6. Air Handler CFM: _____

NOTE: An out